

Certificate of Suitability

Global-Mark Pty. Ltd., certify the electrical equipment described hereunder complies with standards listed herein and notifies the certificate holder to affix the Certificate number and Regulatory Compliance Mark (RCM) mark on the product of the same type provided that the requirements of all relevant parts of AS/NZS 4417 applicable to the article are fulfilled. In placing the Certificate number and/or RCM mark on the product, the Responsible Supplier makes a declaration of compliance with the certification standard(s) and confirms that the product is identical to the product certified herein.

CERTIFICATION AND CERTIFICATE HOLDER DETAILS

Company Name	Suzhou Cyantronic Technology Co., Ltd	Other Name	
Address	No.1 Shenxiang Road, SND Suzhou, Jiangsu 215151 China		
Client ID	109237	Global-Mark File Number:	109237-004
Certification and Authorized Mark Number	GMA-521898	Revision Number	00
Certification Standard(s)	AS 61347.2.7:2019 & AS/NZS 61347.1:2016 Amd 1: 2018 Lamp controlgear – Lamp controlgear –Part 2-7: Particular requirements for battery supplied electronic control gear for emergency lighting (self contained)		
Type of Certification	Electrical Safety Product	Scheme	Global-Mark Electrical Product Safety Certification Scheme

System 1 Approval

CERTIFICATE DATES

Certificate Issue Date	13/02/2025
Certificate Last Update Date	
Certification Expiry Date	13/02/2030

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Page 1 of 7

Certificate of Suitability

CERTIFIED ELECTRICAL EQUIPMENT				
Declared Article	Product Description	Trade Name	Model Number	Rating
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30/MC.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI01-30/MC	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI01-30	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15/MC.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI02-30LFP7302-S20	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30/MC/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI01-30/MC/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI01-30/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15/MC/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Page 2 of 7

Certificate of Suitability

Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30/MC/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15/MC/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-30/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI03-15/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 30-300 Vdc, 8-80 mA, 3W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30/MC	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15/MC	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15/MC	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI04-30LFP7304-S20	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30/MC/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15/MC/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Henri Hobbs

Page 3 of 7

Certificate of Suitability

Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15/MC/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30/MC/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15/MC/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15/MC/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-30/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI08-15/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	ANI05-15/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 30-300 Vdc, 13-130 mA, 5W, Uout:310 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30/MC	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15/MC	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI01-30/MC	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI01-30	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Henri Hobbs

Page 4 of 7

Certificate of Suitability

Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30/MC/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI01-30/MC/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI01-30/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15/MC/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30/ST.	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15/ST	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30/MC/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15/MC/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-30/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI03-15/DA	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI02-30LFP7302-S20	Input: 220-240V~; 50/60Hz; Max. 19mA; Output: 20-55 Vdc, 45-125 mA, 3W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30/MC	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Henri Hobbs

Certificate of Suitability

Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15/MC	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30/MC/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15/MC/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15/ST	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30/MC/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15/MC/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-30/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI05-15/DA	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in
Non declared	Electronic control gear for emergency lighting (Emergency module)	CYANTRONIC	AI04-30LFP7304-S20	Input: 220-240V~; 50/60Hz; Max. 21mA; Output: 20-55 Vdc, 73-200 mA, 5W, Uout:60 Vdc; tc: 75 °C; Built-in

RELEVANT TRADEMARK (S)

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager


Henri Hobbs

Page 6 of 7

Certificate of Suitability

COMMENTS OR CONDITIONS ON THE CERTIFICATION
2025/02/13 Initial Certification
Nil

End of document

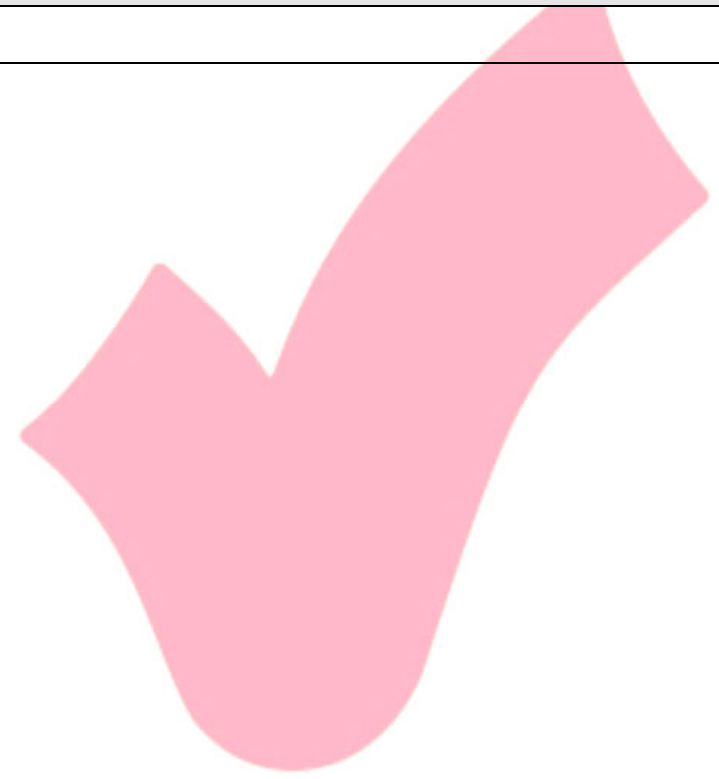

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to www.jasanz.org/register for verification.



Certification Manager

Page 7 of 7